



1) Open Web Browser and type " <http://tnebldc.org> "



2) Click on the link LC

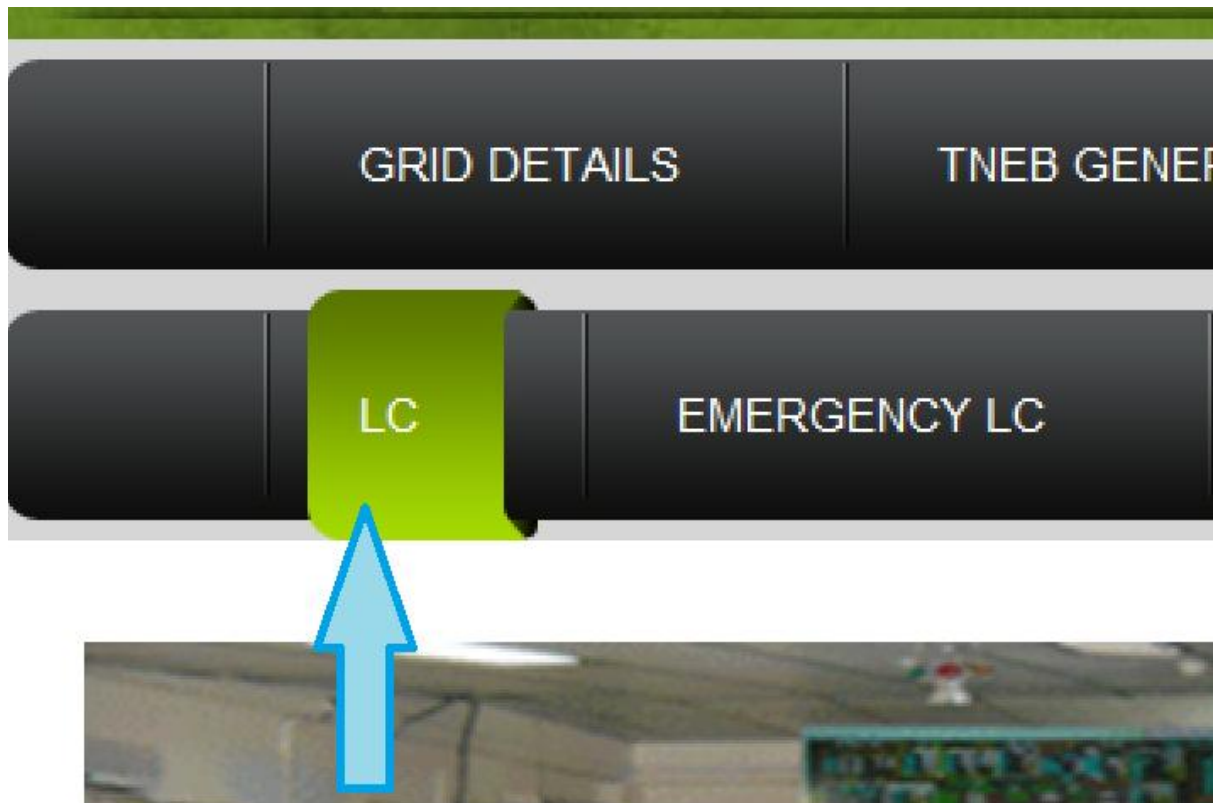

3) or Click on the link EMERGENCY LC

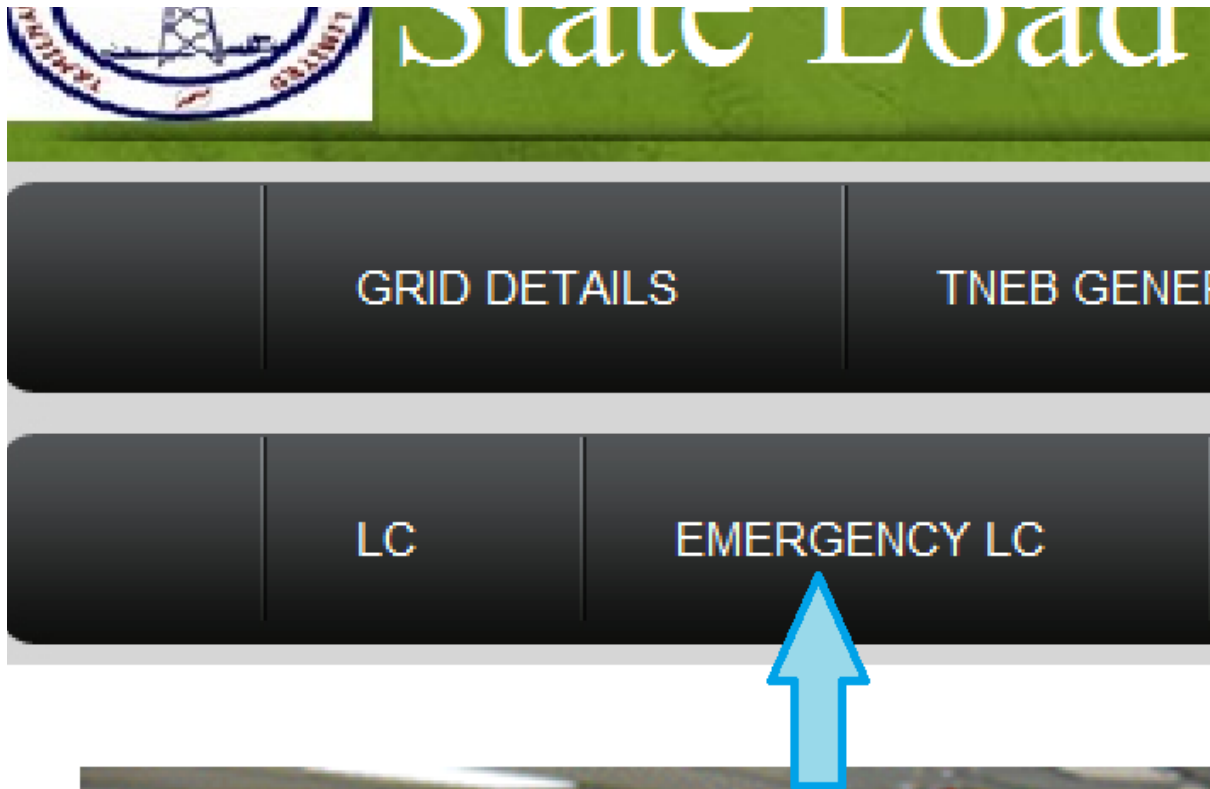

4) The user Name & Password for LC & Emergency LC are same

5) Enter the User Name & Password given to you

EMERGENCY LC LOGIN PAGE

User ID

Password

For support mail to : aeldmtc@tnebnet.org

Note : For complete functioning of this site use JAVA enabled IE6 or higher version

6) Select type of SS/Generating Station

Choose Substation/Generating Station

-Select- ▼

-Select-

400 KV

230 KV

110 KV

GENERATING STATIONS


SLDC

CHENNAI ▼

Upload

7) Choose the SS Name or Generating Station

Choose Substation/Generating Station

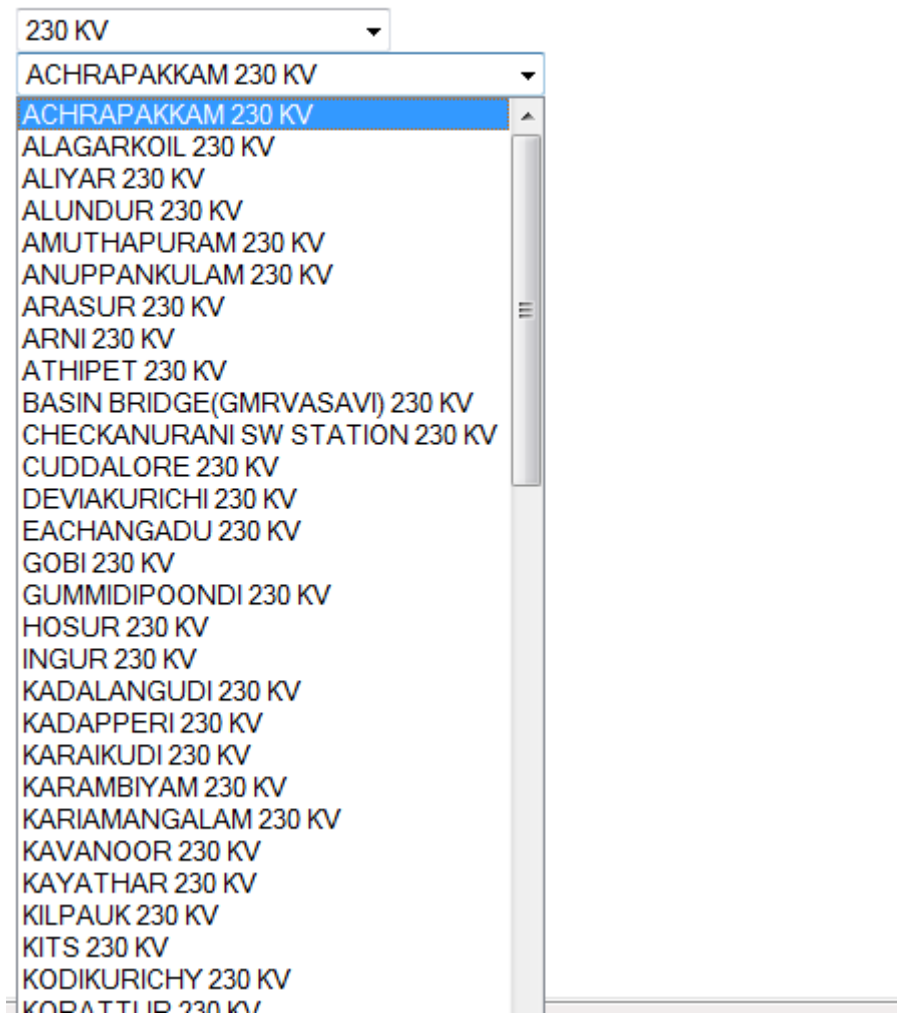

230 KV

ACHRAPAKKAM 230 KV

ACHRAPAKKAM 230 KV

ALAGARKOIL 230 KV

ALIYAR 230 KV

ALUNDUR 230 KV

AMUTHAPURAM 230 KV

ANUPPANKULAM 230 KV

ARASUR 230 KV

ARNI 230 KV

ATHIPET 230 KV

BASIN BRIDGE(GMRVASAVI) 230 KV

CHECKANURANI SW STATION 230 KV

CUDDALORE 230 KV

DEVIKURICHI 230 KV

EACHANGADU 230 KV

GOBI 230 KV

GUMMIDIPOONDI 230 KV

HOSUR 230 KV

INGUR 230 KV

KADALANGUDI 230 KV

KADAPPERI 230 KV

KARAIKUDI 230 KV

KARAMBIYAM 230 KV

KARIAMANGALAM 230 KV

KAVANOUR 230 KV

KAYATHAR 230 KV

KILPAUK 230 KV


KITS 230 KV

KODIKURICHY 230 KV

KODATTI 230 KV

8) Select the concerned SUB LDC for Applying LC.
(I.e Chennai, Madurai, Erode)

SLDC



CHENNAI

CHENNAI

MADURAI

ERODE

9) After selecting press Upload button

SLDC

CHENNAI

Upload

10) The Form will open.

LC MESSAGE

Today's Date: Tuesday, October 16, 2012 Time: 2:43:40 PM SLDC: Chennai

Message No: [] From: [] Type Of SS: 230 KV

SS/GeneratingStation: ACHRAPAKKAM 230 KV Feeder Equipment: []

From Date: Wednesday, October 17, 2012 From Time: 00

To Date: Wednesday, October 17, 2012 To Time: 00

Purpose: []

Condition: []

Responsibility (Applied by): [] (Entered/Uploaded) by: []

Upload Correction Page Log Out View LC APPROVAL view History

11) After entering all the values press **Upload** button.

12) The following link will open :

1 record added


ID	Message No	From	Type Of SS/GeneratingStation	Name Of SS/GeneratingStation	Feeder/Equipment	From	To	Nature of Work	Applied by	Condition	Entered by	SLDC	Date of Entry	Time of Entry	UID
Auto index	test	test	230 KV	ACHRAPAKKAM 230 KV	test	Wednesday, October 17, 2012_00:00	Wednesday, October 17, 2012_00:00	test	test	test	test	Chennai	Tuesday, October 16, 2012	2:49:55 PM	trichy230kv


ADD LC EXIT

13) To add another LC press **ADD LC** button .

14) To apply LC for other SS press **ADD LC (DIFFERENT SS)** button.

15) To make any correction **Correction Page** button has to be pressed and the correction can be made in that page.

16) The LC Approval for tomorrow can be viewed by clicking  button. Check the LC status after 18:00 Hrs.

17) The LC Status of past and future LC (In case of holidays) can be viewed by clicking  button.


18) Choose the date from



19) Click the calendar button



20) The calendar popup will show

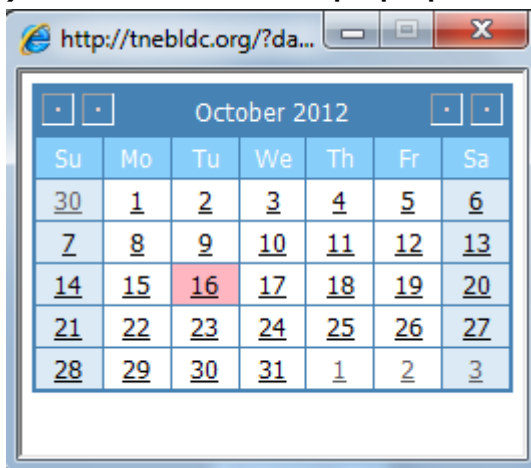

choose the date by choosing the month and date.

21) The following report will be available

Monday, October 15, 2012

SS Name	P_Id	Message No	From	Type of SS	Name of SS	Feeder Equipment	From date	From time	To date	to time	Purpose	Condition	RESPONSIBILITY	Applied by	Recomendation	Remarks	SE Approval
oragadam230kv	18	285	EE/OPN	230 KV	ORAGADAM 230 KV	230KV ORD-SPR#	Monday, October 15, 2012	09:00	Monday, October 15, 2012	21:00	MMW	ALL OTHER#S WILL BE IN SERVICE.NIS	JE/MTCE	GOWTHAM TA	no	sub jghsfdkjdsv	yes
VILLUPURAM230KV	19	286	EE/OPN	230 KV	VILLUPURAM 230 KV	230KV VPM-APAKKAM#	Monday, October 15, 2012	09:00	Monday, October 15, 2012	17:00	MMW	NIS	AEE/MTCE	APPRENTICE	no	rgsdrthrs ddfgesrthsrejm	yes
ATHIPET230KV	20	287	EE/OPN	230 KV	ATHIPET 230 KV	100MVA AUTO TR	Monday, October 15, 2012	12:00	Monday, October 15, 2012	14:00	FOR RELEASING GAS	ALL OTHER #S WILL BE IN SCE EXCEPT 33KV ZUARI#	AE/TRE	NAGARAJAN/AEE/S	no	no	yes

logout

22) LC can be applied from Tomorrow to next three days (totally four days).

23) The procedure for Emergency LC is the same as that of normal LC except that Emergency LC can be applied with in the day.